Catalogue No: **ELTSA**

EMERGENCY LIGHTING TEST UNIT PUSH BUTTON (ENCLOSED TYPE)

Power Distribution and Protection > Distribution Boards > Panelboards > General Panelboard Hardware / Accessories > Panelboard Emergency Lighting Test Kits > Enclosed - Surface Mount

Representative Photo Only
(actual product may vary based on configuration selections)

Emergency Lighting Test Unit, Rotary Switch (Enclosed Type)

Emergency lighting test switch, to semi automate the testing of emergency lighting. The test switch is one central point to trigger emergency lights for required regular testing as per AS/NZS 2293 standards. Easily able to be retrofit into Panelboard's to allow regular maintantence testing of single point emergency lights. Kit comes complete with contactor with 4 N/C contacts, addtional contactors can be pigbacked. Timer can be set for 120mins (inital test) or 90 mins (regular test). Unit comes complete with labels to easily indentify supply MCBs.

SPECIFICATIONS	
Component Type Power Distribution & Protection	Emergency Lighting Kit
Width	160 mm

REFERENCES	
IECEx Certificate	-
Supplier Declaration of Conformity:	-
Installation Guide:	-
User Manual:	-
Manufacturer Datasheet:	-
Manufacturer Catalogue & Product Selection:	-

Catalogue No: **ELTSA**

EMERGENCY LIGHTING TEST UNIT PUSH BUTTON (ENCLOSED TYPE)

Power Distribution and Protection > Distribution Boards > Panelboards > General Panelboard Hardware / Accessories > Panelboard Emergency Lighting Test Kits > Enclosed - Surface Mount

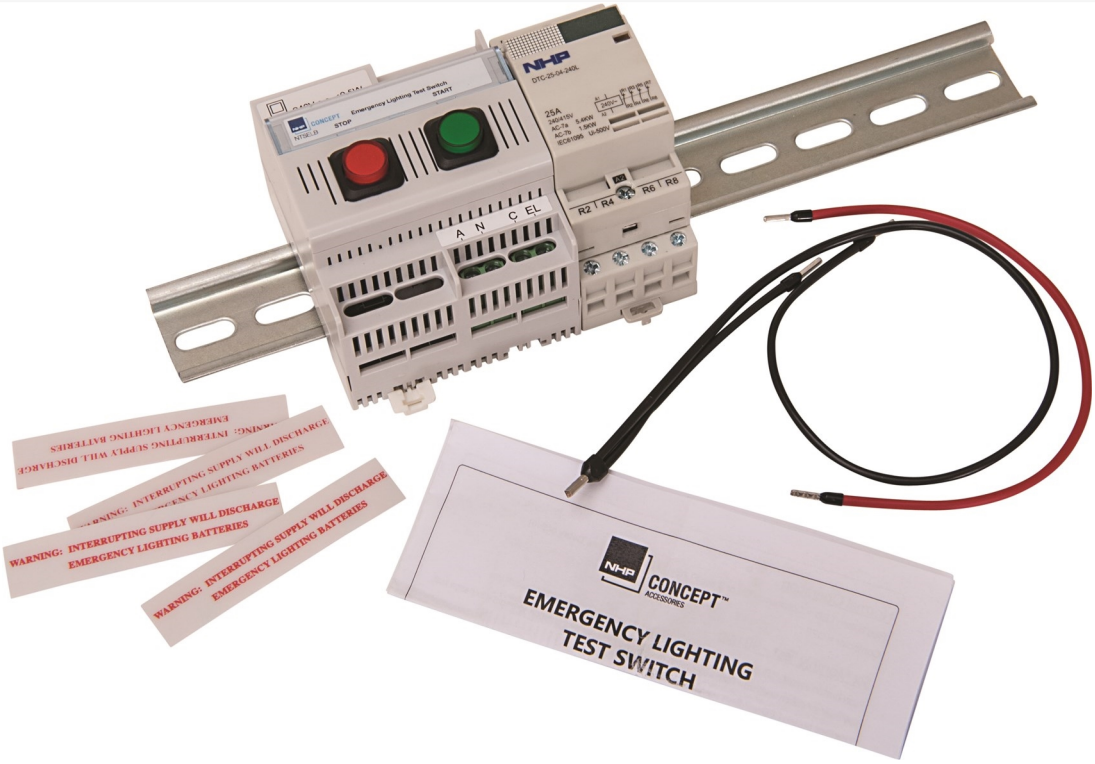

Dimension Diagram

Cat No:
ELTSA / CELAELK1W
Push button operator

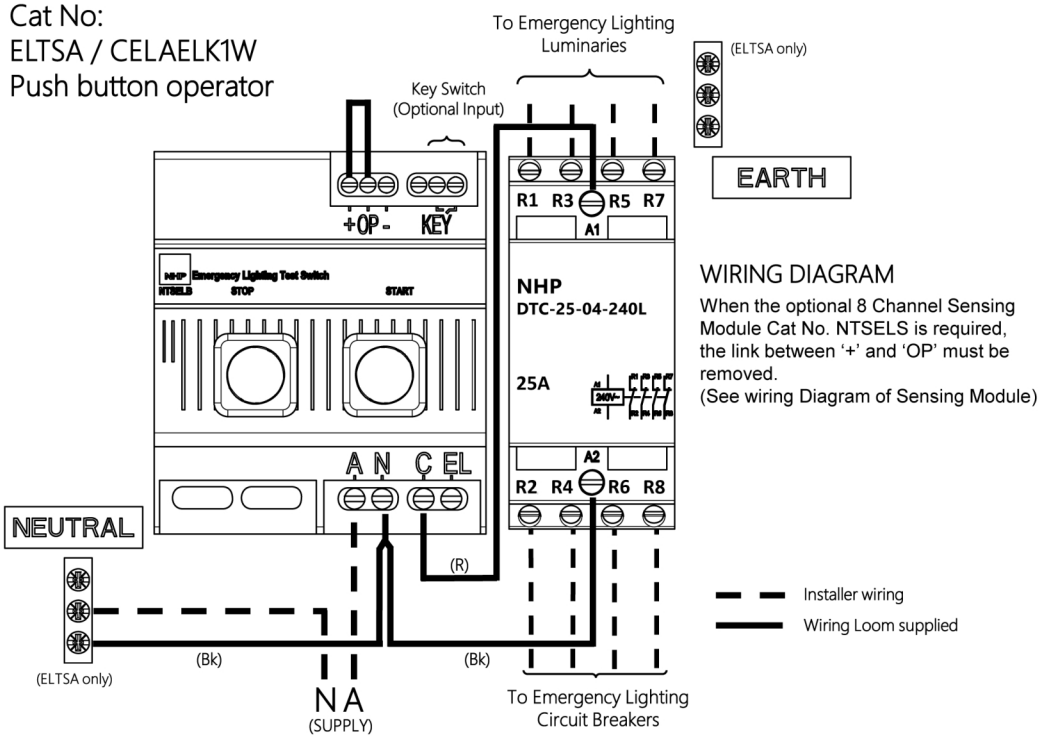

WIRING DIAGRAM

When the optional 8 Channel Sensing Module Cat No. NTSELS is required, the link between '+' and 'OP' must be removed.
(See wiring Diagram of Sensing Module)

Connection / Wiring Diagram